

ELAPSED TIME INDICATORS AND EVENT COUNTERS




999A Series Enclosures

L-3 Electroynamics, Inc. offers customized enclosures to house a variety of Elapsed Time Indicators and Event Counters. The customized enclosures include the connectors, wire leads and mounting brackets, as required, for mounting into final assemblies. Refer to the Elapsed Time Indicator and Event Counter sections of the catalog for mechanical, electrical and environmental specifications.

DC series Elapsed Time Indicators meet or exceed requirements of MIL-M-7793-M7793/1, /2, /5 and MS21341 A & B.

AC series Elapsed Time Indicators meet or exceed applicable requirements of MIL-M-7793-M7793/3, /4, /6, /8, /9, /10 (if QPL'd), MS27650 and MS21651.

ENCLOSURE EXAMPLES

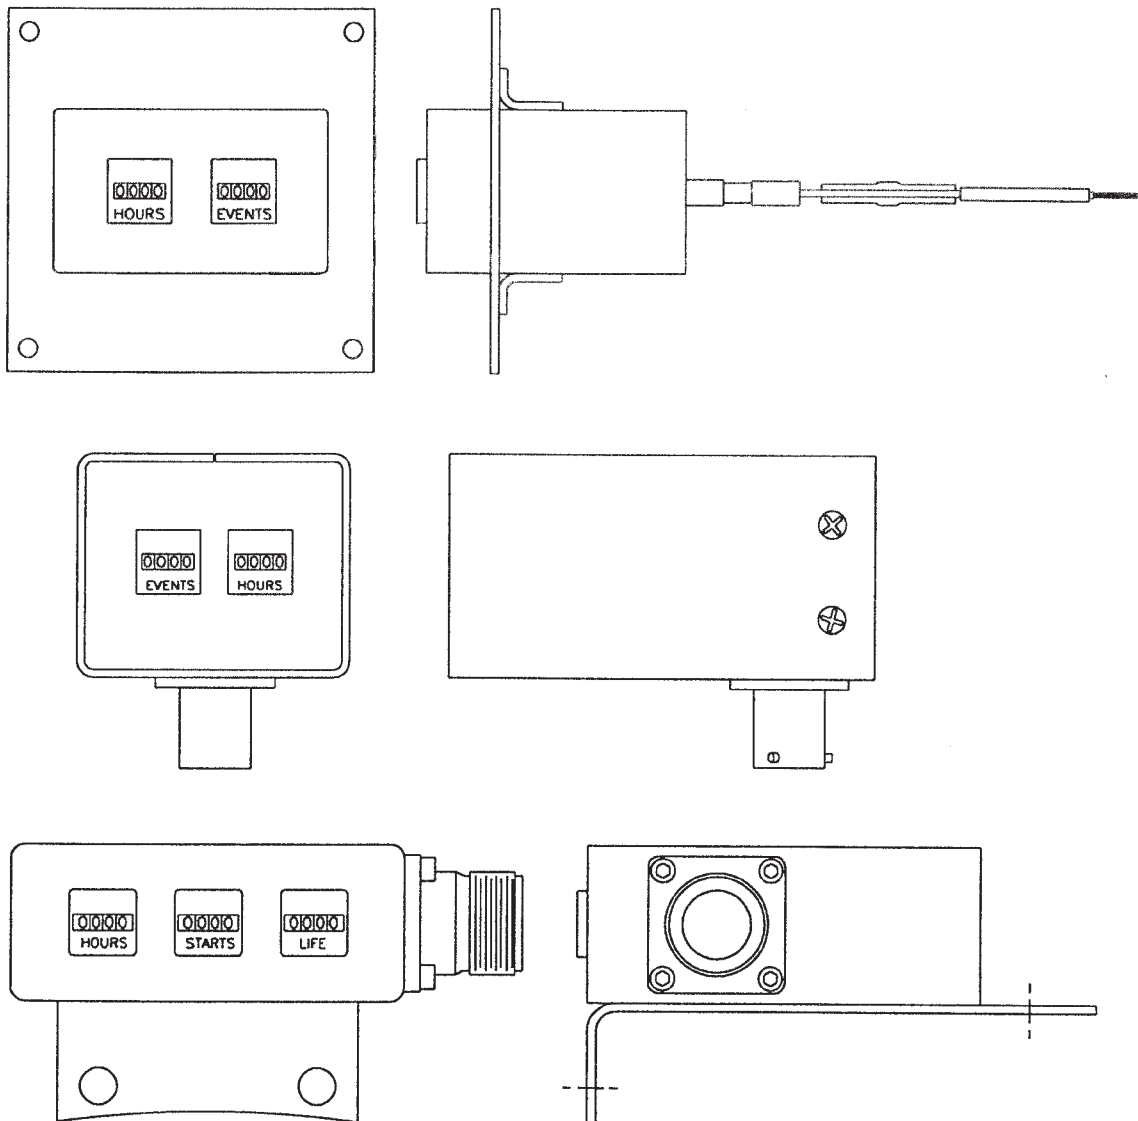

This page consists of basic marketing information that is not defined as technical data under EAR Part 772.